
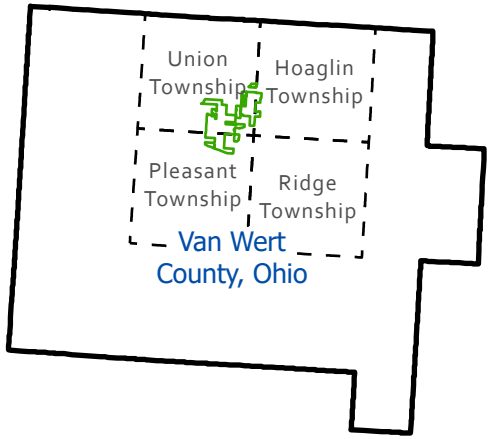


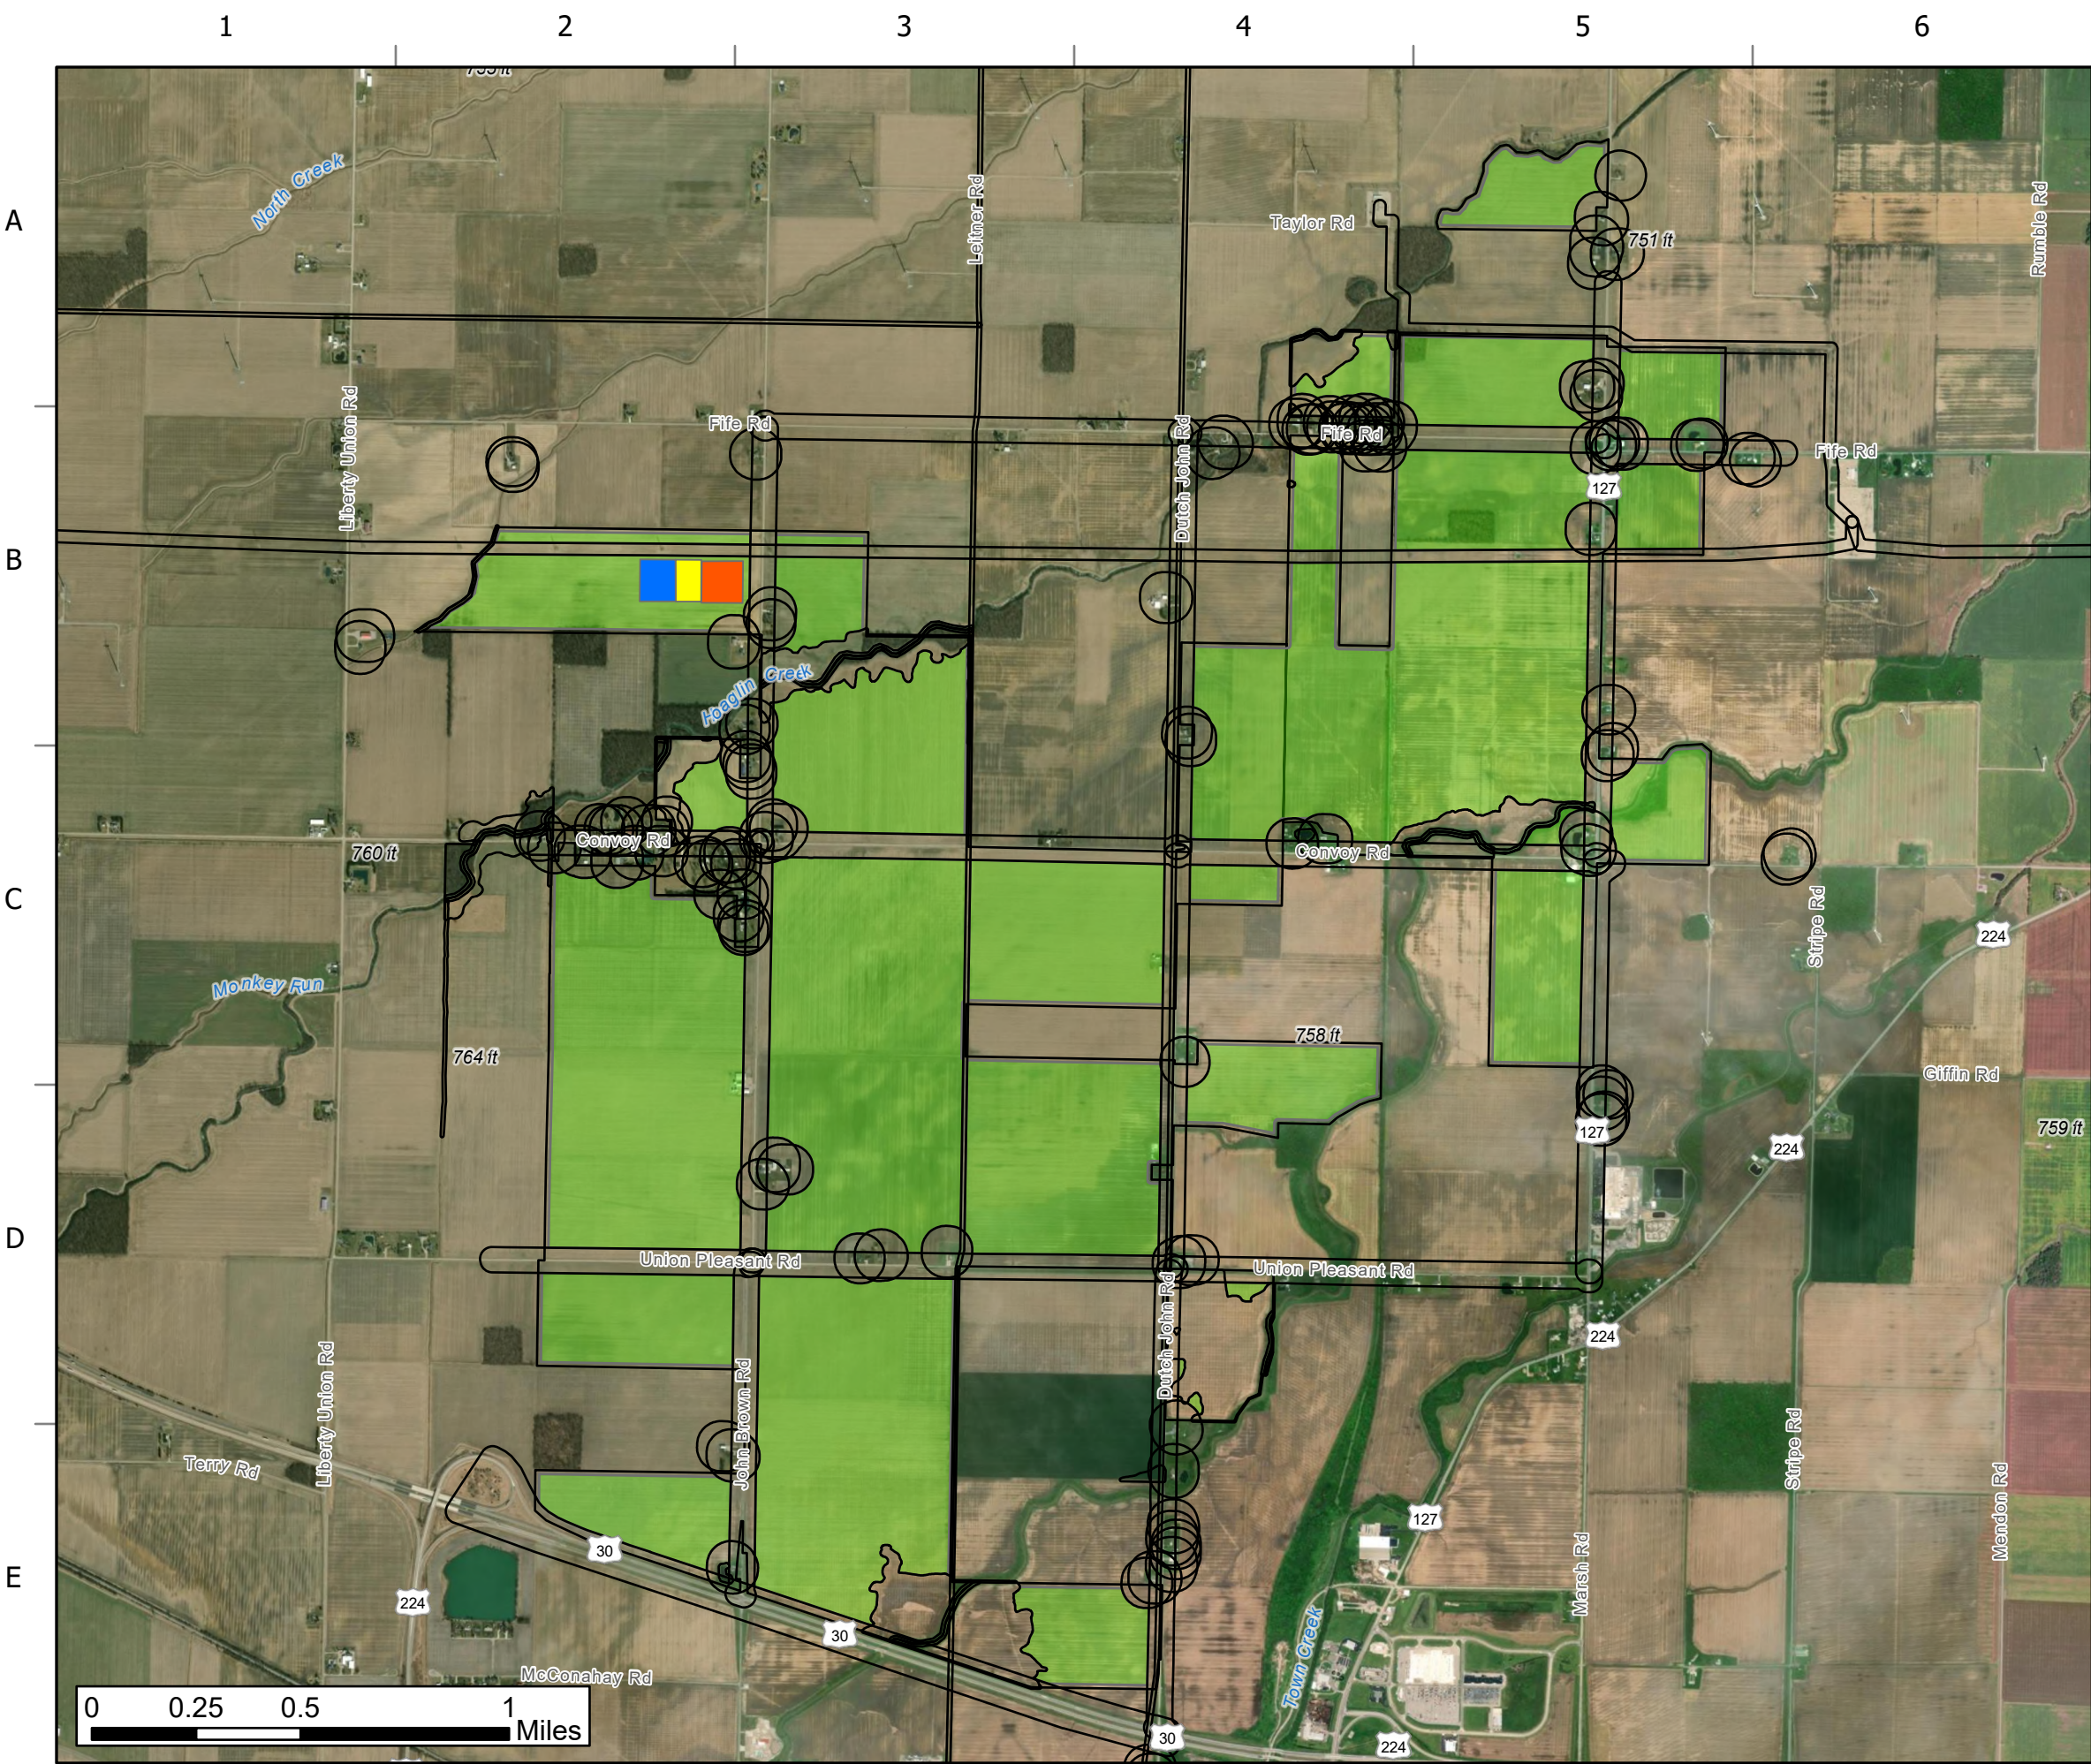

- Minimum Distance to Solar Arrays
- Non-participating property boundary: 50ft
 - Residential structure: 300ft
 - Public Road: 150ft from edge of pavement
 - Wetland/Floodplain: 20ft
 - Transmission Lines 69kV: 25ft
 - Transmission Lines 345kV: 75ft

- BESS Area
- Collection Substation
- Interconnection Substation
- Array Acreage

NOTES:
The area in green is eligible for panel placement under current OPSB regulations. Of this acreage, only a portion of it will be needed to meet capacity requirements. Urban Grid invites feedback and participation from the community to help understand which portions of this acreage is optimal for the final placement of features. Our final site plan will incorporate this feedback and be presented at the next Public Interest Meeting.

Buildable Area

Butterfly Meadows

SITE OVERVIEW

Spatial Reference

WKID: 6595
Spatial Reference
Name: NAD 1983 2011 StatePlane Ohio
North FIPS 3401 F1 US
GCS: GCS NAD 1983 2011
Datum: NAD 1983 2011
Map Units: Foot US

Created by: CY

8/5/2026